





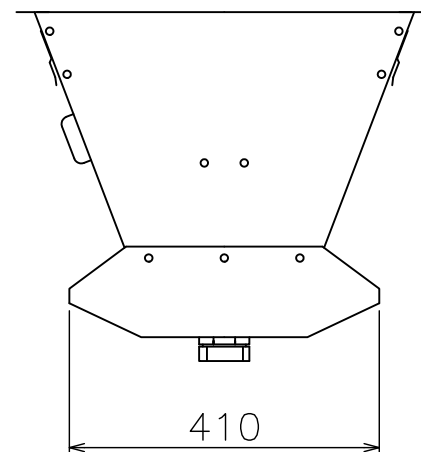


A technical drawing of a mechanical assembly, likely a mold or a container, with numbered callouts 1 through 9. The assembly consists of a base (3) with a central opening (2) and a top flange (1). A central vertical rod (4) passes through the opening, with a U-shaped component (7) attached to its lower end. Two angled rods (5) are connected to the top flange and the central rod. A rectangular component (8) is attached to the side of the top flange. A small rectangular component (6) is attached to the top flange. A small rectangular component (9) is attached to the central rod. A dashed line indicates a hidden internal feature.

型 式	W	A	B	C	本体質量(kg)	水切フィルター必要枚数	貯水量(L)
NBJ－ 600W	606	5	116.0	16	23.7	300×250×4枚	6.1
NBJ－ 750W	756	7	104.3	20	27.4	300×250×2枚	7.7
						450×250×2枚	
NBJ－ 900W	906	8	110.0	22	30.6	450×250×4枚	9.1
NBJ－1050W	1056	10	103.0	26	34.3	450×250×2枚	10.7
						600×250×2枚	
NBJ－1200W	1206	11	107.3	28	37.5	600×250×4枚	12.3
NBJ－1500W	1506	14	105.7	34	44.5	600×250×4枚	15.3
						300×250×2枚	

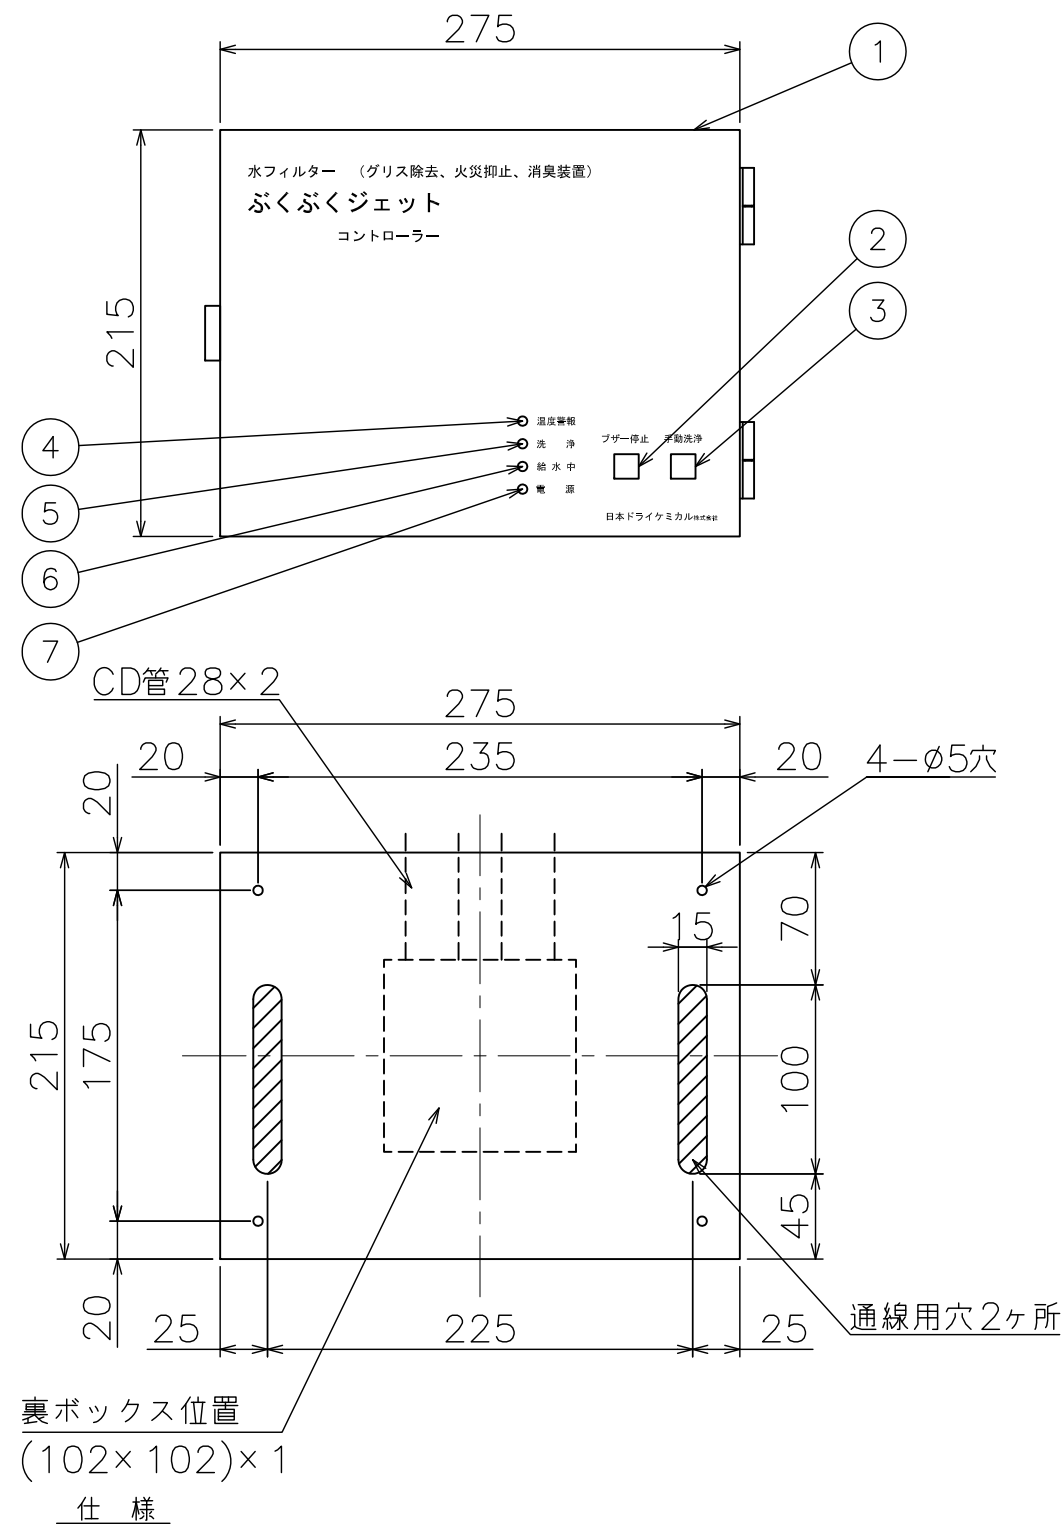



外 寸	275W×215H×60D		
材 質	鋼板製 1.0t		
質 量	約3kg		
入力電源	AC100V 50/60Hz 単相		
消費電力	200W		
タイマー	入力方式	洗浄時刻	9回/1日
		洗浄時間	30秒~9分
塗 装	マンセル5.17GY8.43/0.59 メラミン焼付塗装		
制御台数	NBJ本体 5台まで制御		

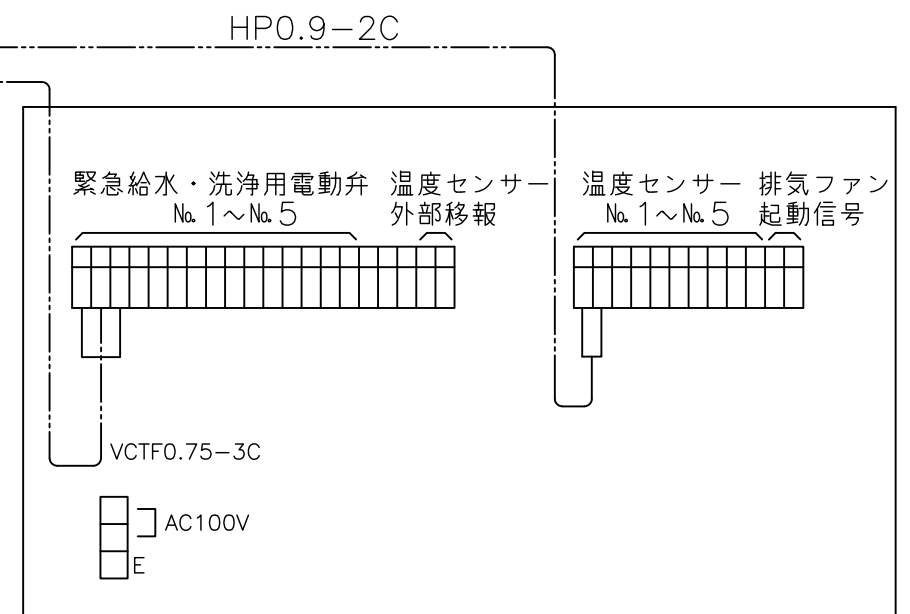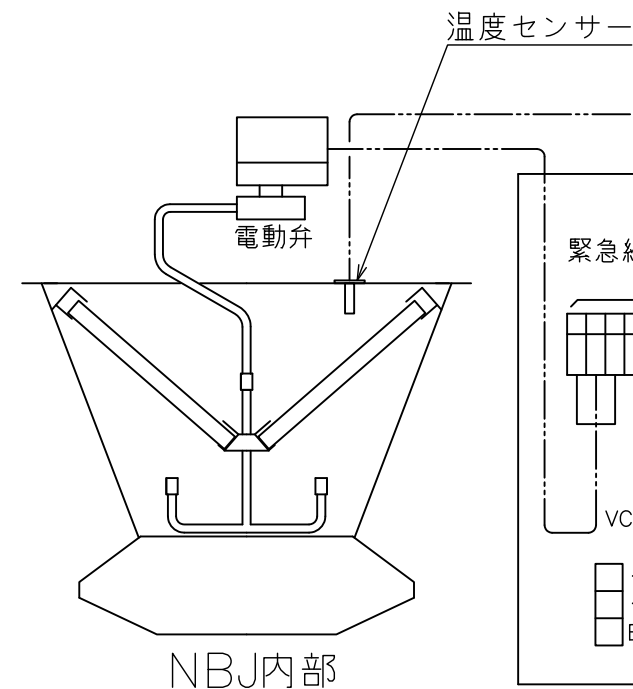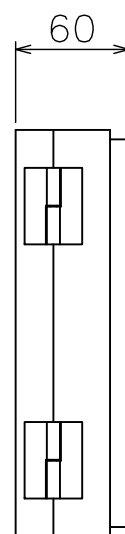


制御盤内部配線図

品番	品 名	備 考
1	箱体	
2	ブザー停止押ボタン	赤色
3	手動洗浄押ボタン	緑色
4	温度警報ランプ	赤色
5	洗浄ランプ	緑色
6	給水中ランプ	緑色
7	電源ランプ	緑色

月 日	2026.07.03	作 成	綴木	審 査	鍋川	承 認	畑本	名 称	ぶくぶくジェット NBJ型 制御盤	
日本ドライケミカル株式会社								図 番	CZM002	2

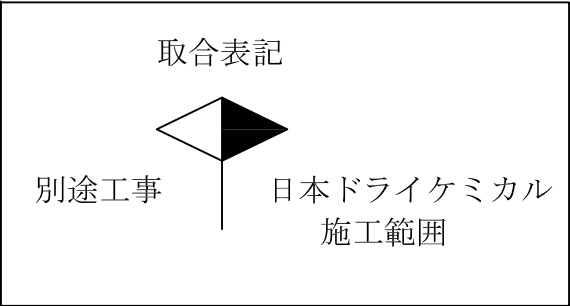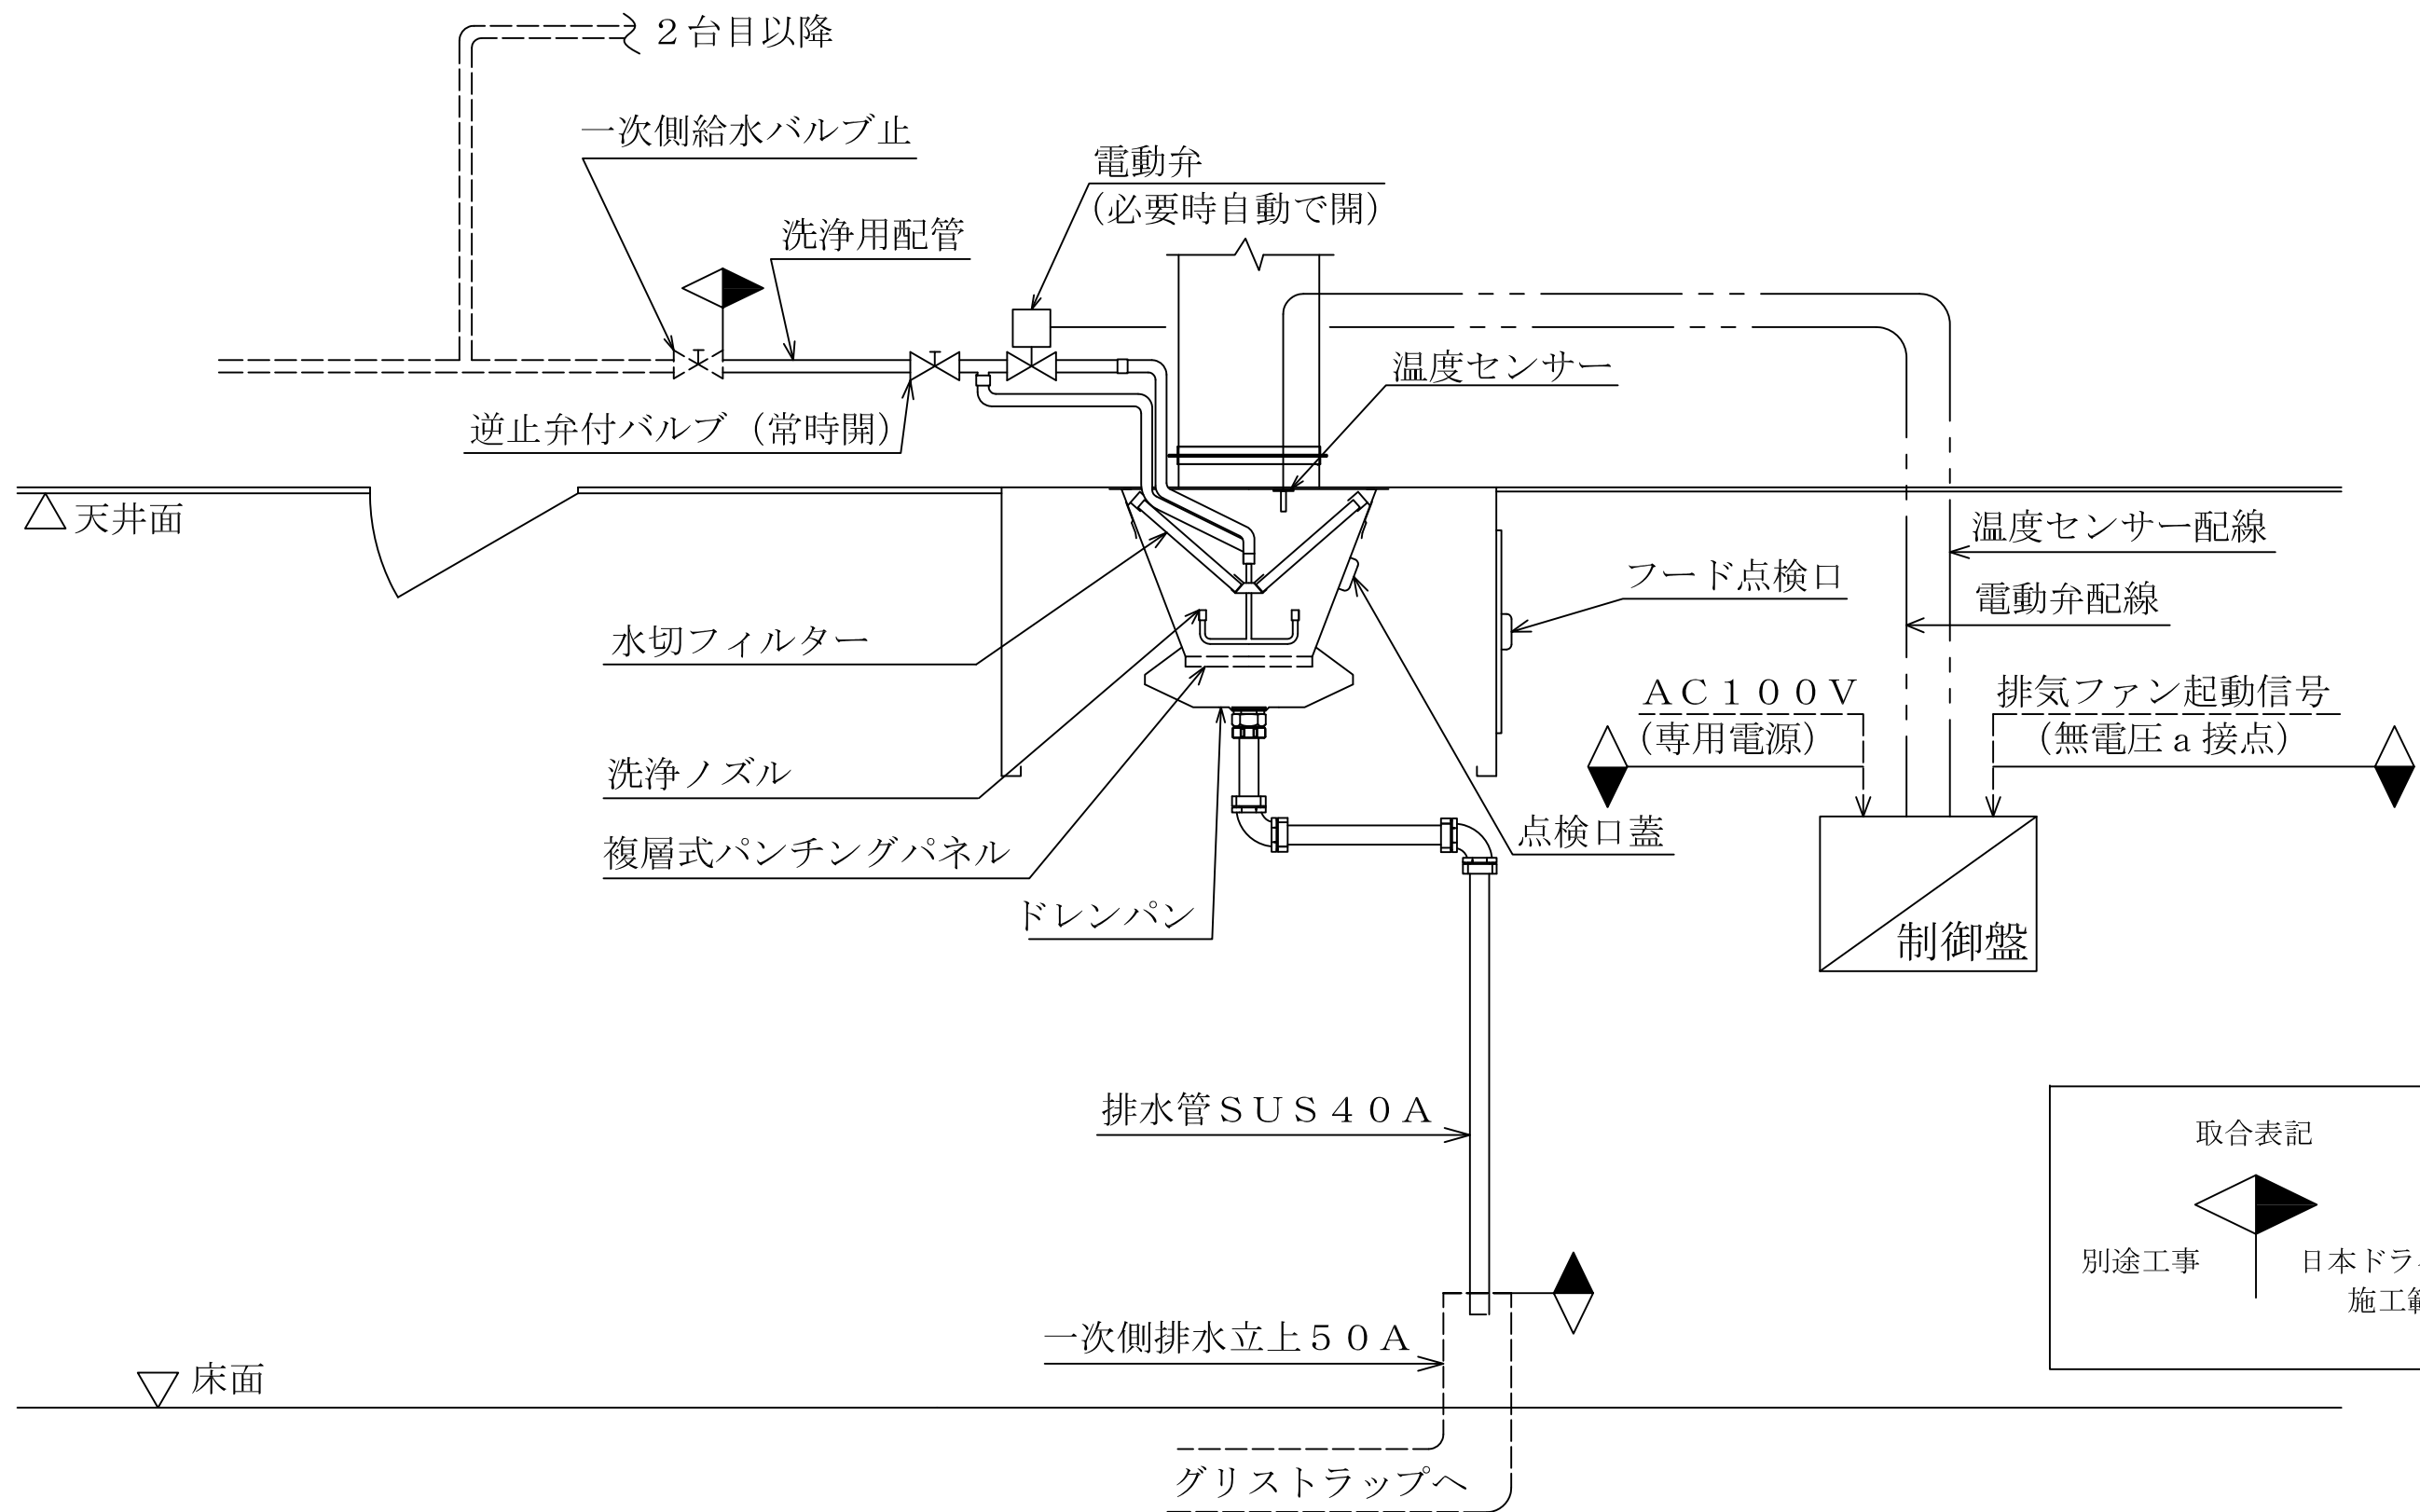

月日	2026.07.03	作成	綴木	審査	鍋川	承認	畑本	名称	全体システム図		
日本ドライケミカル株式会社									図番	CZM004	1

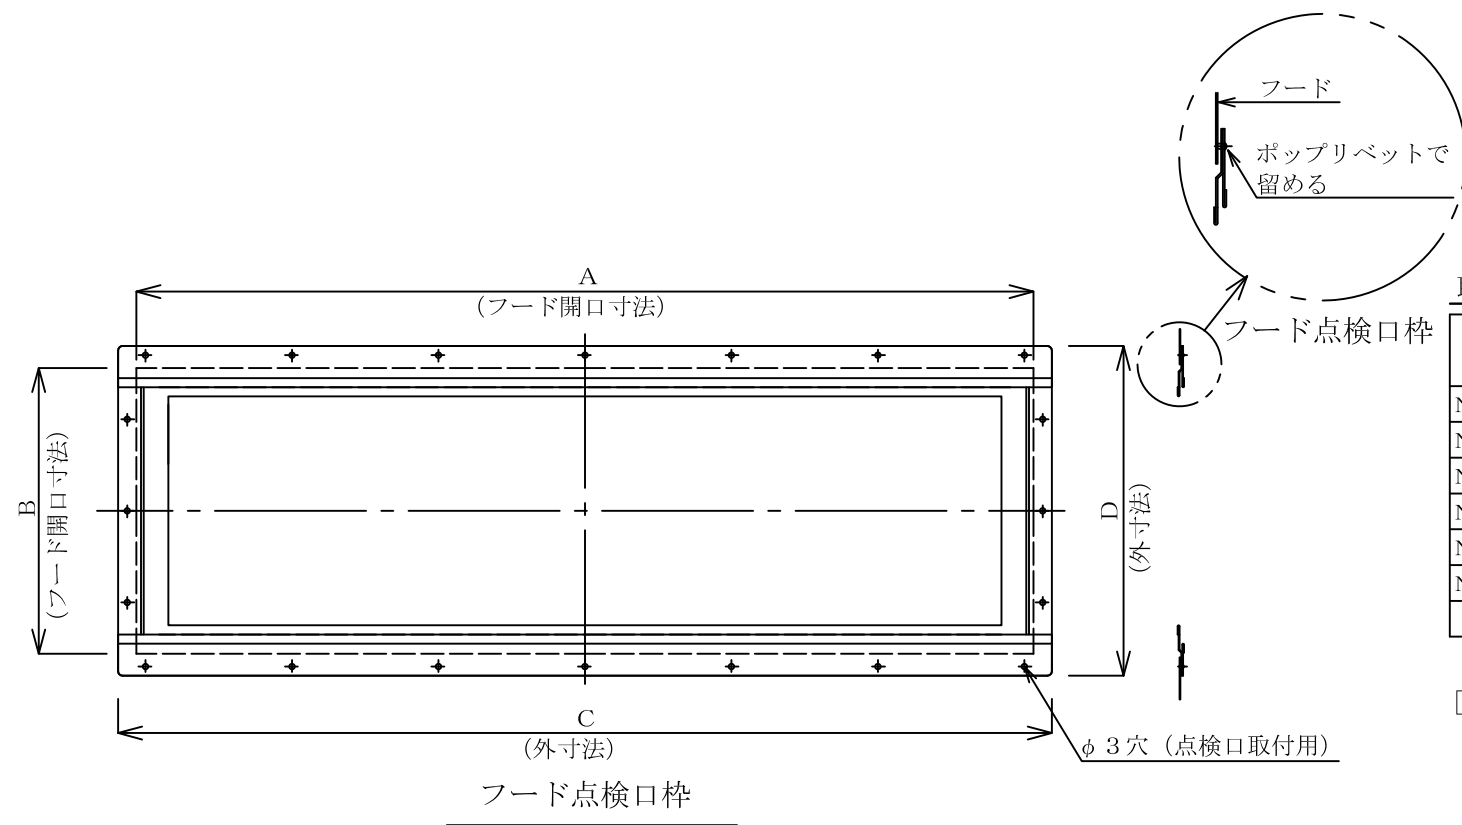


取付寸法表


型番	フード開口		フード点検口外枠		フード点検蓋		重量 (kg)	備考
	A	B	C	D	E	F		
NBJ-600W	660	300	696	336	645	284	4.0	
NBJ-750W	810	300	846	336	795	284	4.5	
NBJ-900W	960	300	996	336	945	284	5.0	
NBJ-1050W	1110	300	1146	336	1095	284	5.5	
NBJ-1200W	1260	300	1296	336	1245	284	6.3	
NBJ-1500W	1560	300	1596	336	1545	284	7.4	

下記取付手順参考

- 〔特長〕 ・うす型で取付が簡単です。
・仕上げは、SUS304BA材です。

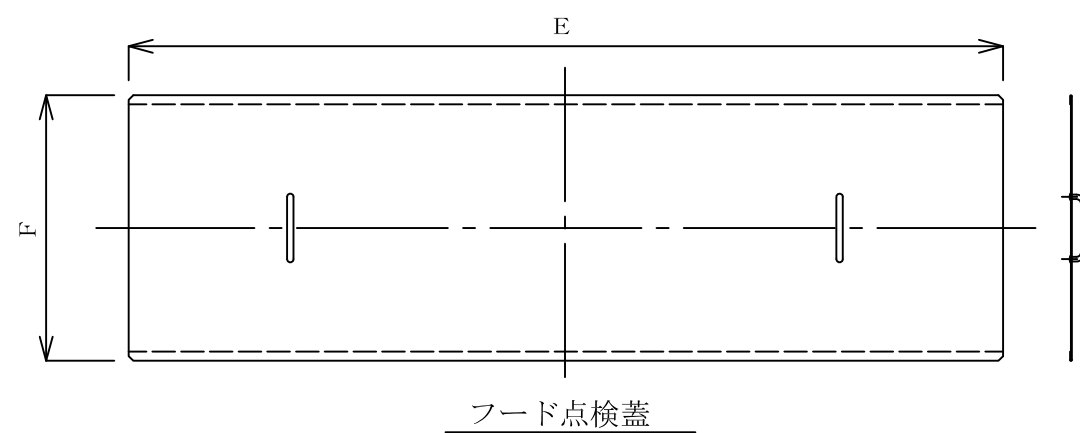


取付手順

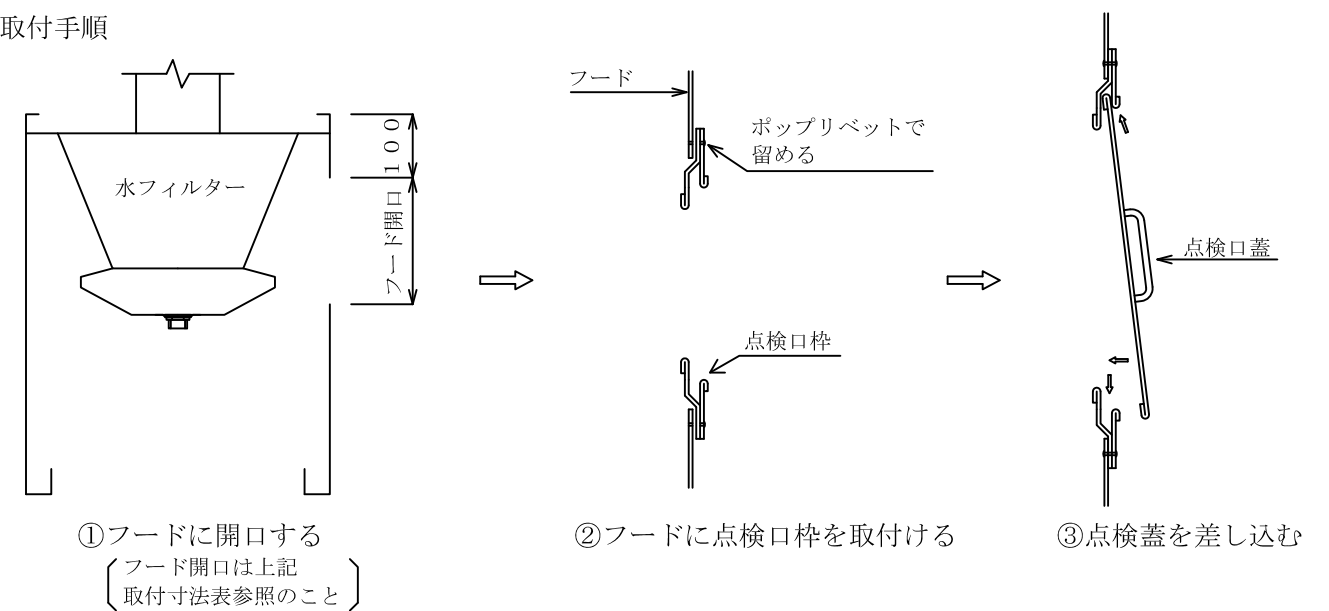


月日	2019.04.10	作成	綴木	審査	畑本	承認	猪瀬	名称	フード用点検口	
日本ドライケミカル株式会社								図番	CZM005	


通常動作フロー

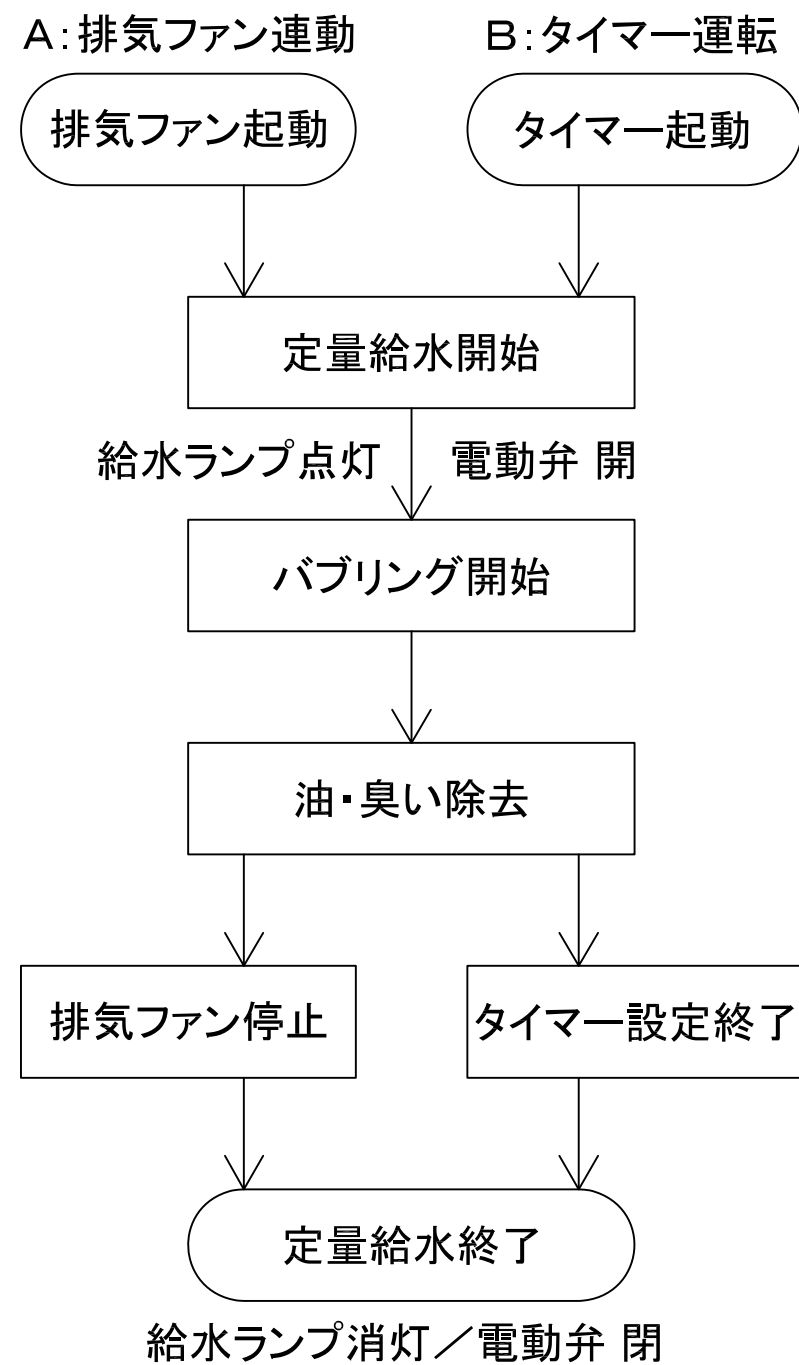

メドレー洗浄フロー


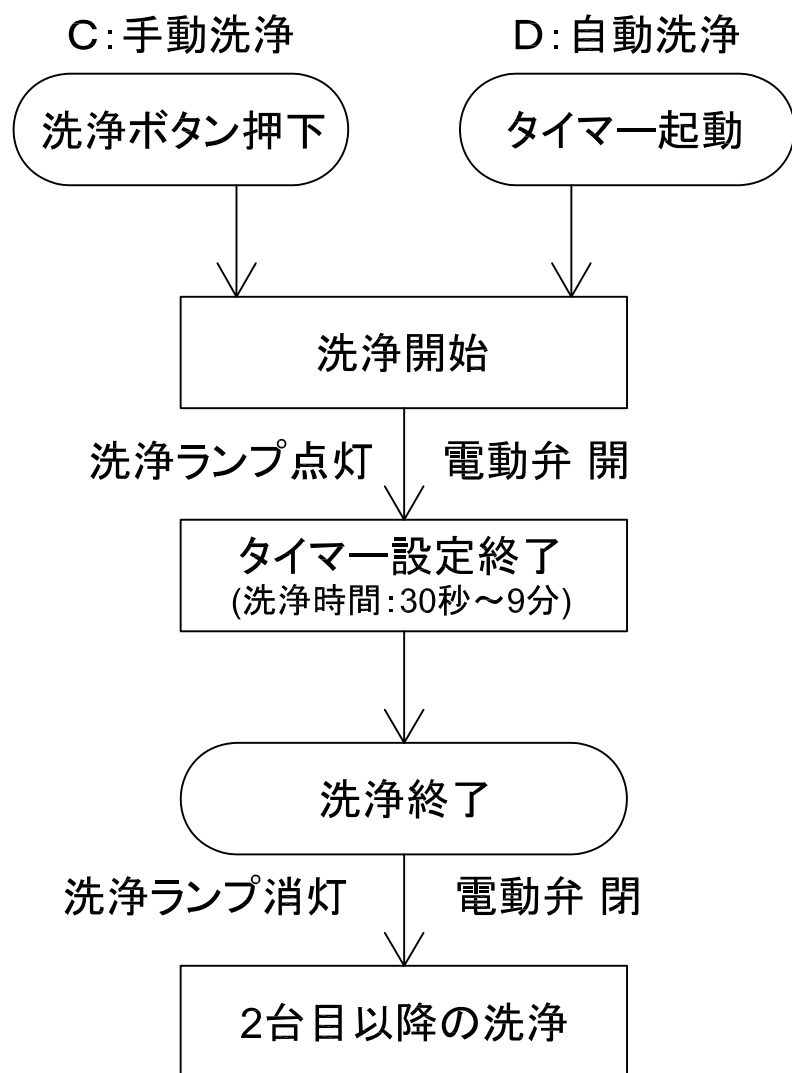


火災抑止フロー

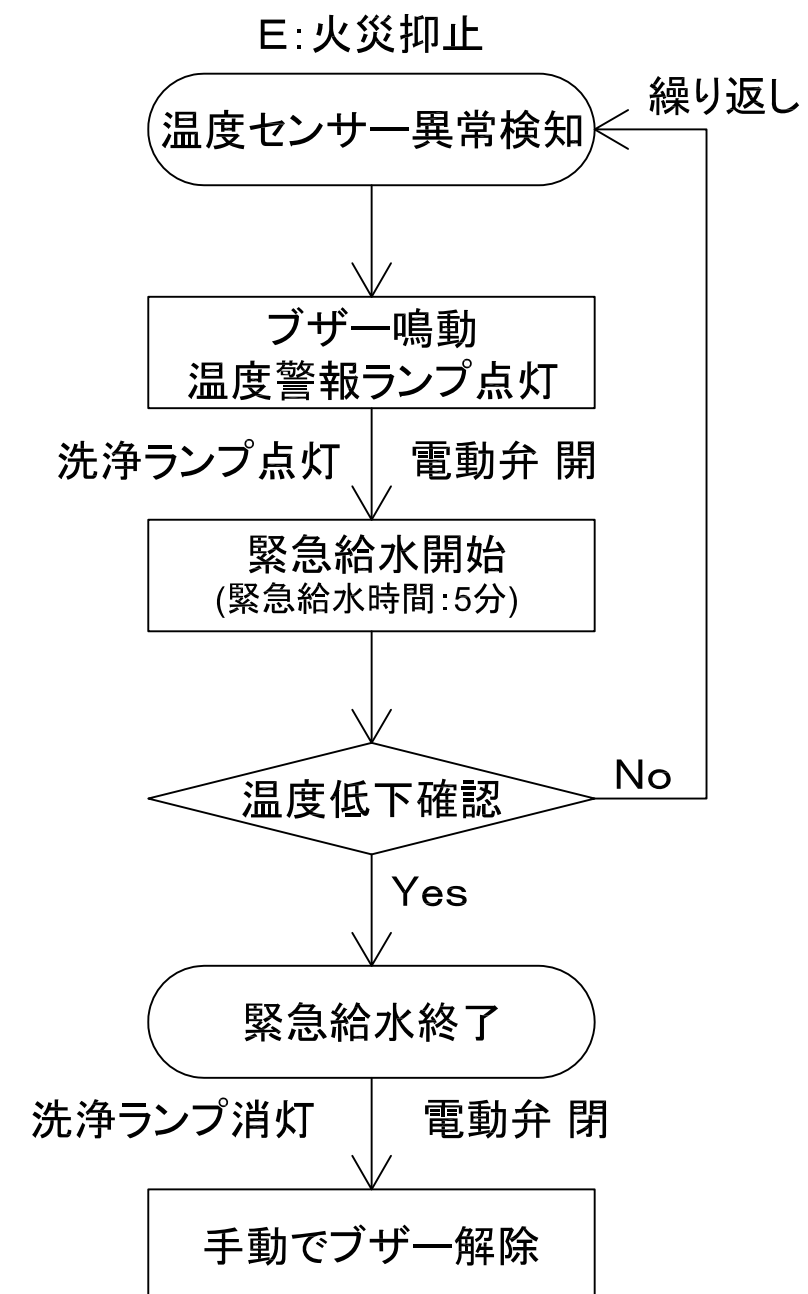

月日	2026.07.03	作成	綴木	審査	鍋川	承認	畑本	名称	フローチャート		
日本ドライケミカル株式会社								図番	CZM006	1	

品番	品名	材質	数量	備考
1	電動弁		1	20A 桑名金属工業(株)(B201-SU3/4)
2	逆止弁付ボール止水栓		1	Rc1/2 カクダイ: 653-510-13

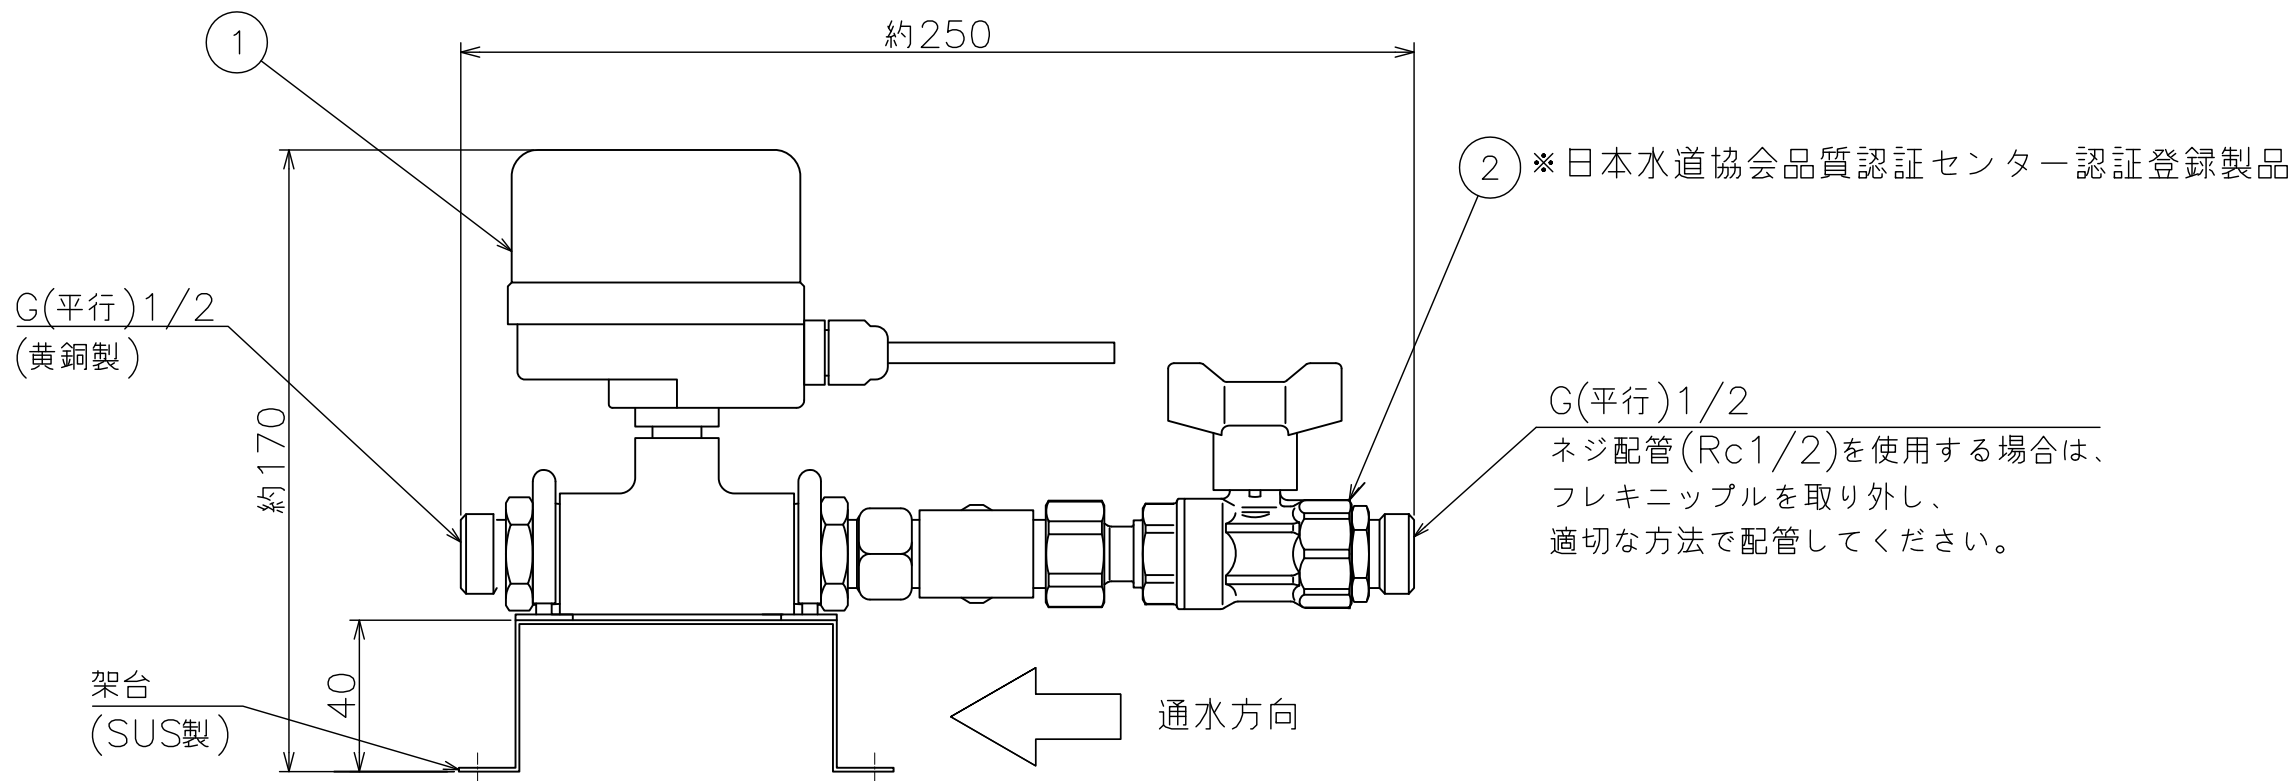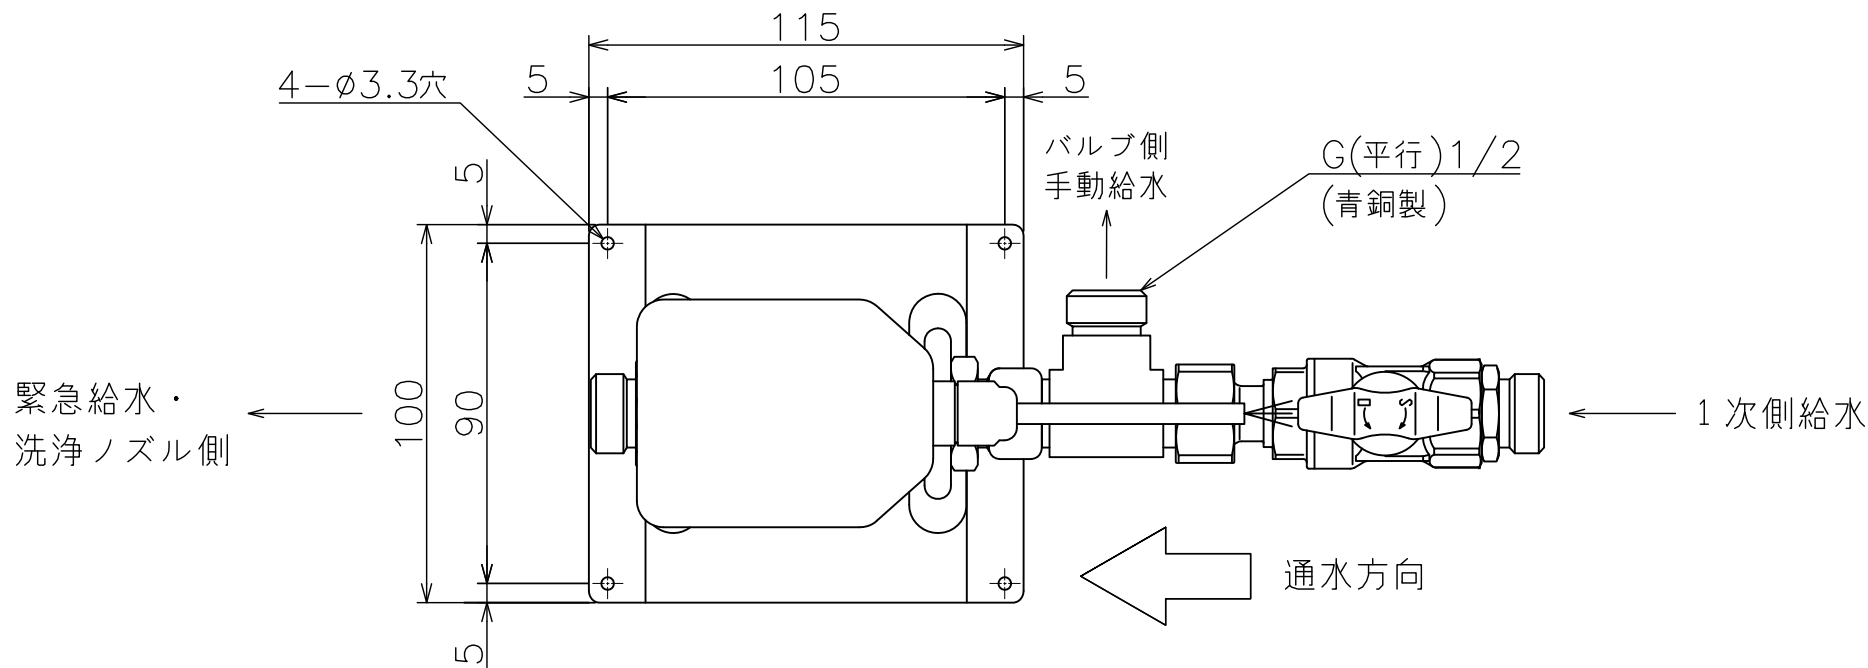

月日	2026.07.03	作成	綴木	審査	鍋川	承認	畑本	名称	電動弁ユニット	
日本ドライケミカル株式会社								図番	CZM009	